

# CERTIFICATE OF COMPLIANCE

## Subsystem

**Holder:** Indave, S.A.

**Subsystem(s):** 24 Final Element Subsystems Series

**Basis of Certification:** IEC 61508:2010  
IEC 61511:2016

**Certification Include(s):** ☒ Hardware requirements  
☒ Reliability requirements

**Functional Safety Data:**

**Safety Instrumented Function:** When de-energising the solenoid valve(s) in the control panel the actuator will move the valve to the safe state (tight shutoff or full open) within the specified safety time

**Functional Safety Parameters:** See next page

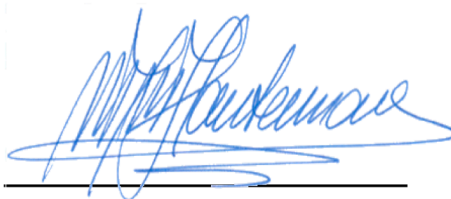
**Certification Results:**

Risknowlogy certifies that the above Subsystems meet the requirements of the Basis of Certification for the selected assessment(s). Risknowlogy report 2722.399.4 is an integral part of this certificate.

**Certificate Number:** 2722.399.5

**Issue Date:** 2018-05-10

**Expiry Date:** After modification of subsystem(s)

**Certifier:**

dr.ir. Michel Houtermans



# CERTIFICATE OF COMPLIANCE

## Subsystem

**Holder:** Indave, S.A.

**Subsystem(s):** 24 Final Element Subsystems Series

**Basis of Certification:** IEC 61508:2010  
IEC 61511:2016

**Certification Include(s):** ☒ Hardware requirements  
☒ Reliability requirements

**Functional Safety Data:**

**Safety Instrumented Function:** When de-energising the solenoid valve(s) in the control panel the actuator will move the valve to the safe state (tight shutoff or full open) within the specified safety time

**Functional Safety Parameters:** See next page

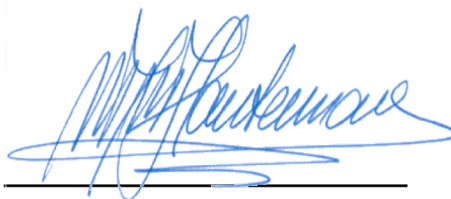
**Certification Results:**

Risknowlogy certifies that the above Subsystems meet the requirements of the Basis of Certification for the selected assessment(s). Risknowlogy report 2722.399.4 is an integral part of this certificate.

**Certificate Number:** 2722.399.5

**Issue Date:** 2018-05-10

**Expiry Date:** After modification of subsystem(s)

**Certifier:**

dr.ir. Michel Houtermans

